


Overhead Routes Studied, But Rejected from Consideration



Land Use Constraints

- ▲ Existing Substation/Switching Station
- △ Proposed Substation/Switching Station
- ▲ Future Switching Station
- Existing Dominion Transmission Line
- - - Proposed Switching Station Footprint
- - - Study Area
- Option 1 Route 3
- Option 1 Route 4
- Option 2 Route 1
- Option 2 Route 2
- Option 2 Route 3
- Option 2 Route 4
- Planned Developments
- Government Owned Land**
- City of Manassas
- Prince William County
- Commonwealth of Virginia
- United States

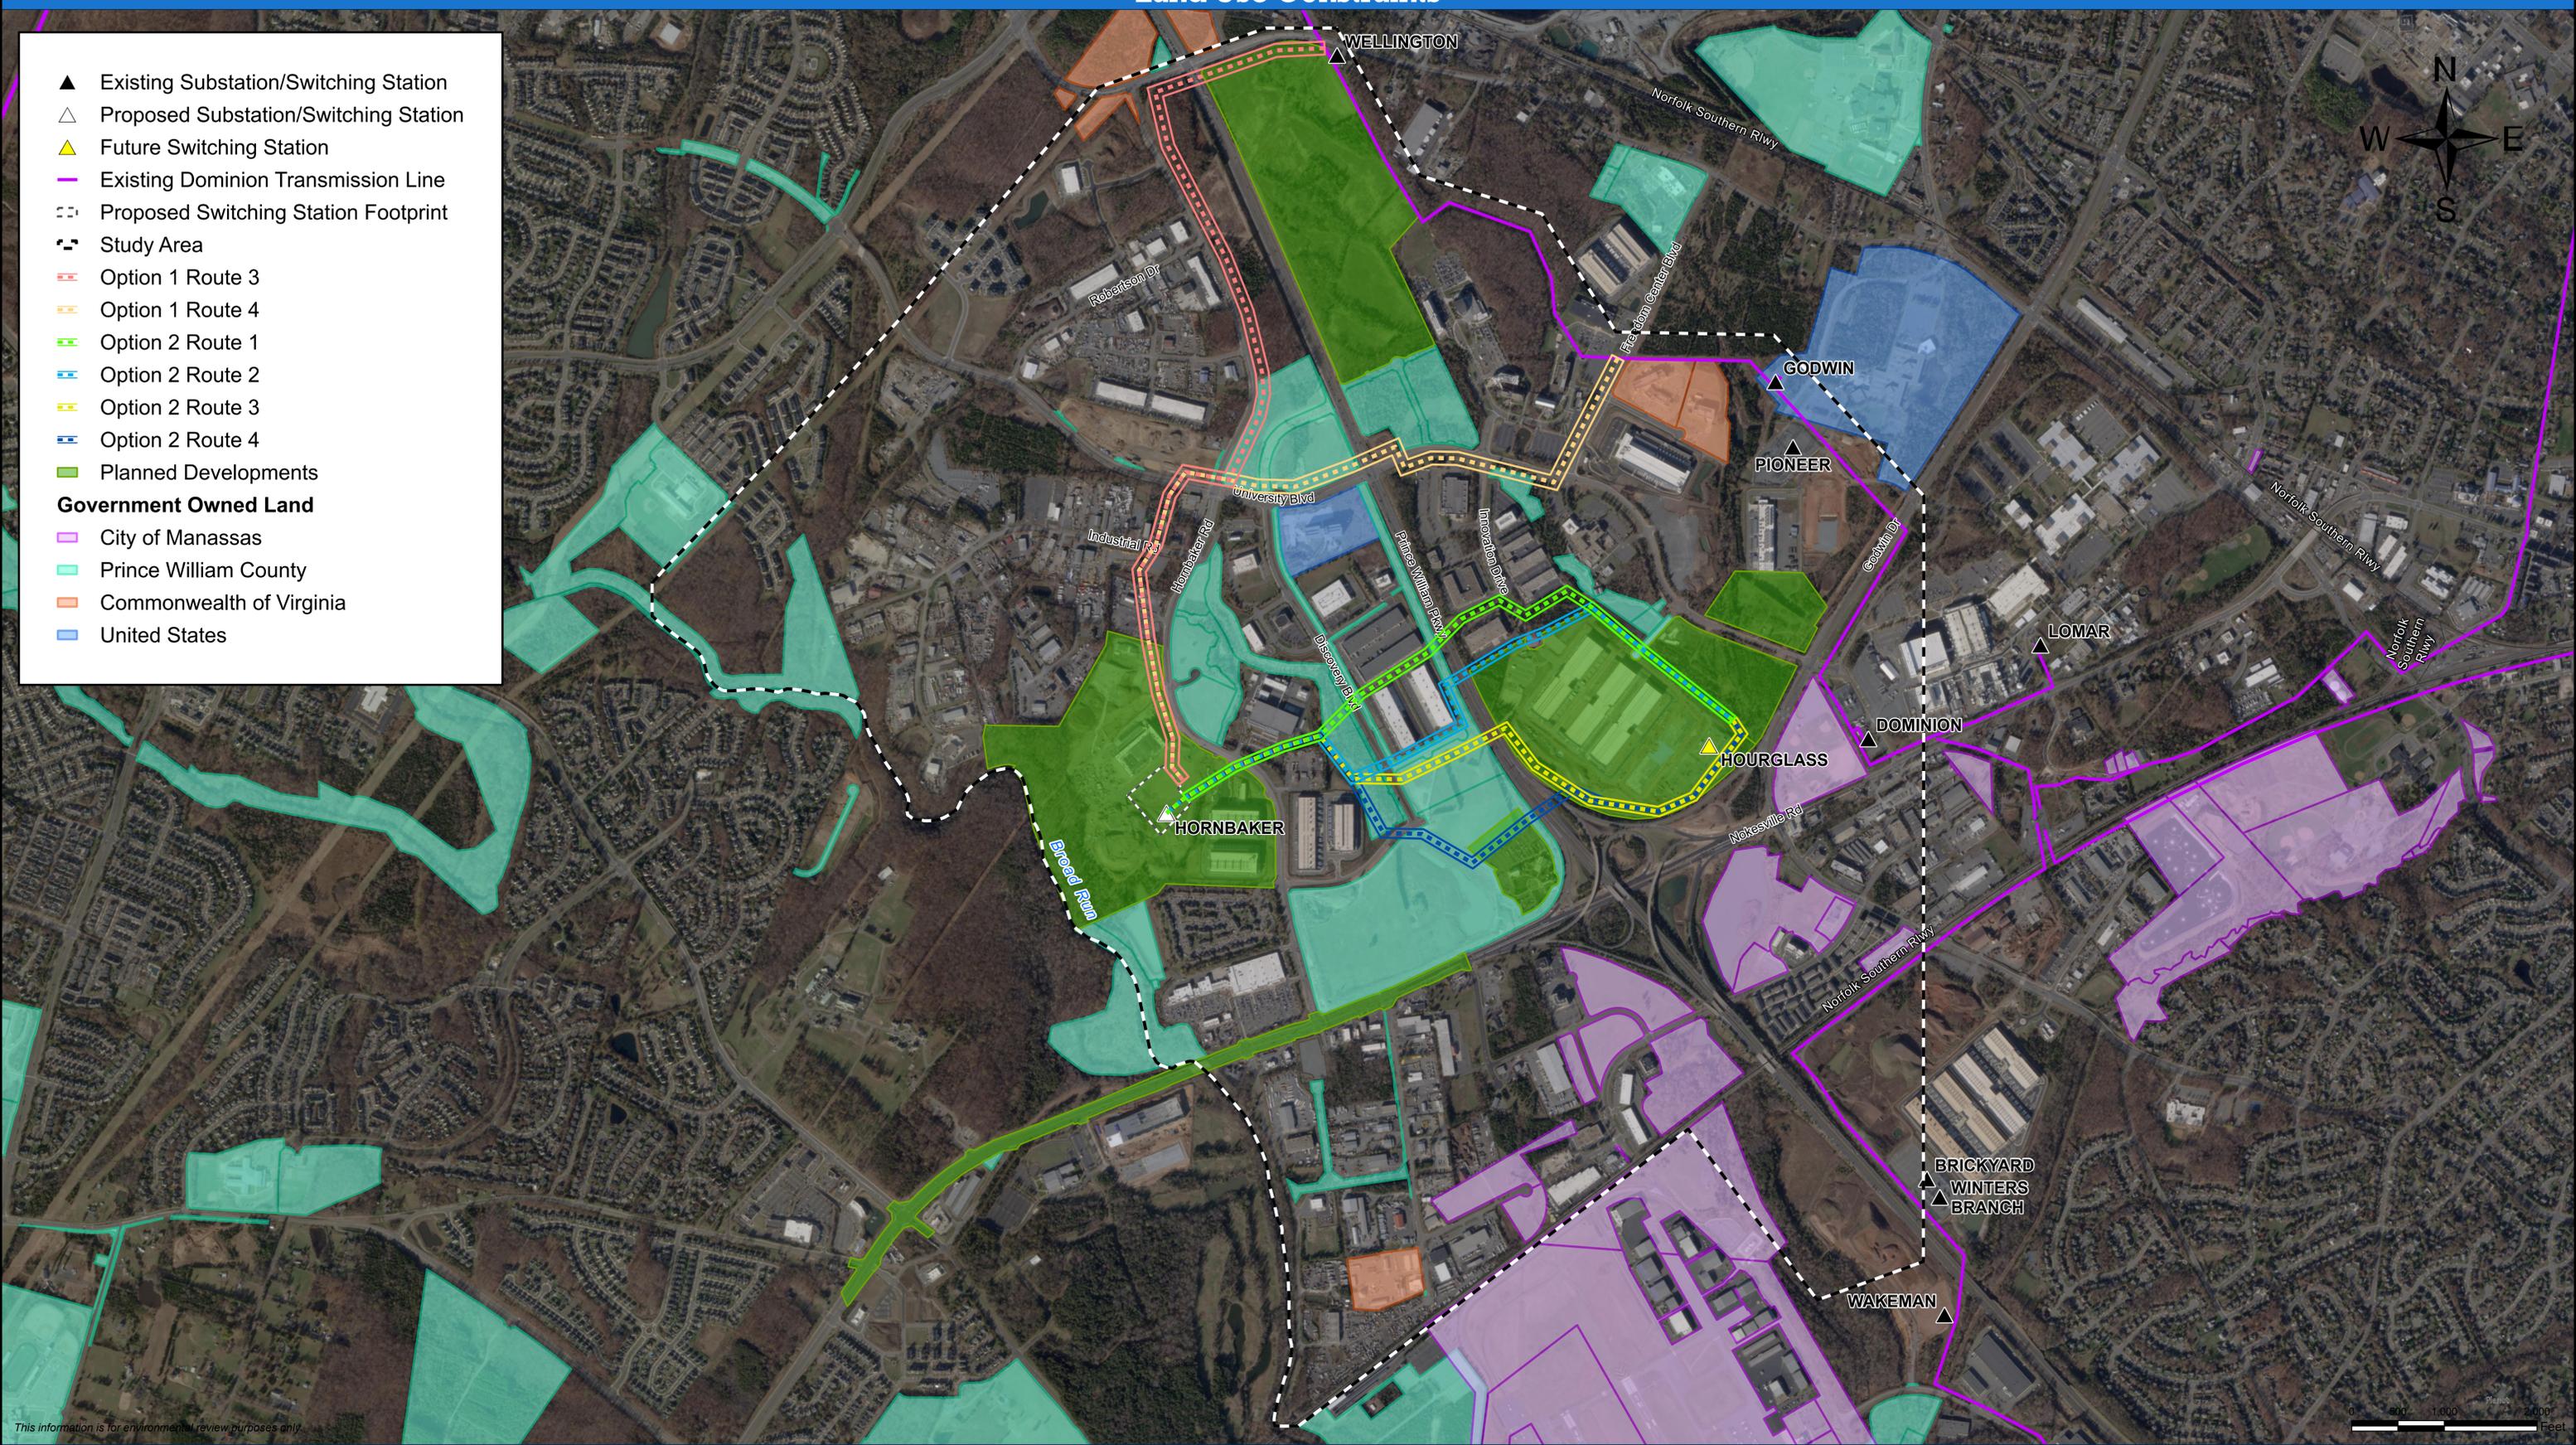

This information is for environmental review purposes only.

Hornbaker 230 kV Line and Hornbaker Switching Station Project